
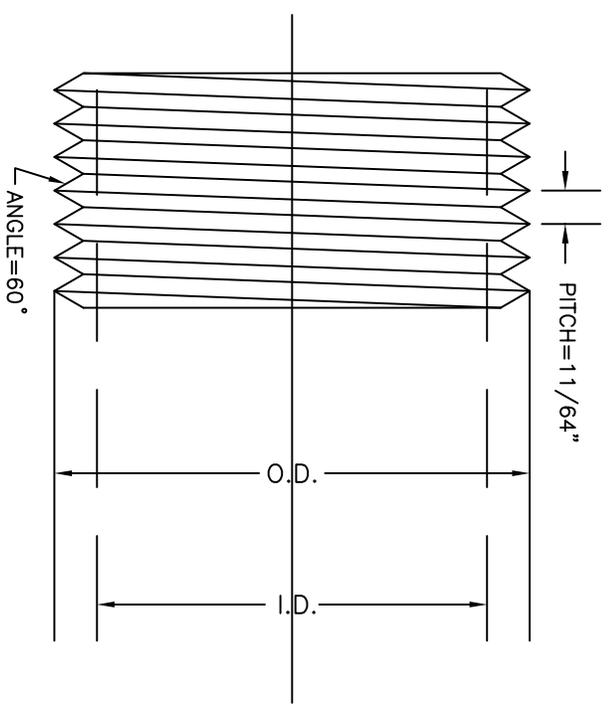


FIRE HYDRANTS MANUFACTURERS SHALL BE
KENNEDY K-81-A, DARLING
OR MUELLER CENTURION

DO NOT BLOCK WEEP HOLES

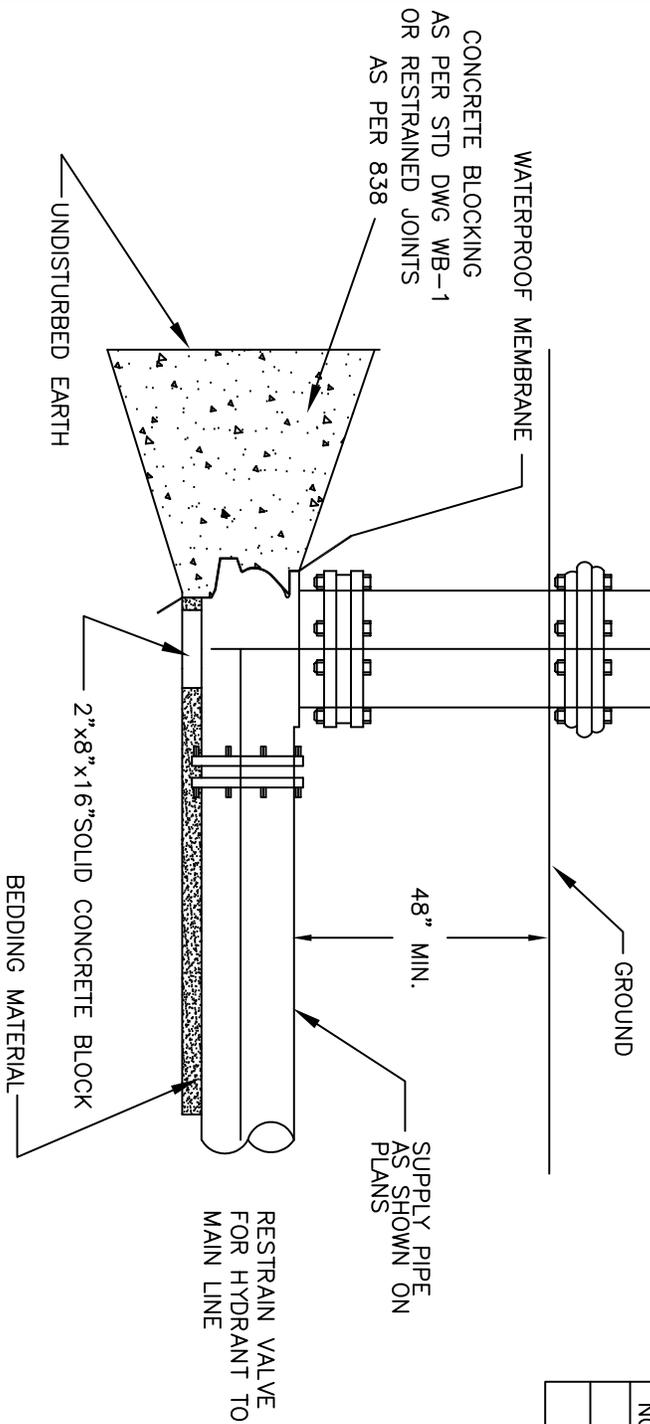

NOMINAL NOZZLE SIZE	O.D.	I.D.
4" NOZZLE	4.875"	4.0"
2 1/2" NOZZLE	3.250"	2.5"

NOTE:
HIGBEE CUT, SHARP V,
6 THREADS PER INCH
HYDRANT NOZZLE
DETAIL

CITY OF SPRINGFIELD, OHIO DEPARTMENT OF ENGINEERING	
FIRE HYDRANT DETAIL	
DATE JUL 98	
STANDARD DRAWING FH-1	
APPROVED _____	CITY ENGINEER